

## **STATEMENT OF WORK AND TECHNICAL DESCRIPTION OF THE GOODS**

### **Context:**

NCA Afghanistan is implementing a lifesaving WASH project for the EQ affected people in Herat comprises of one water supply scheme containing of RCC reservoir, bore well, distribution main and sub pipes and House to House connection stand tapes. Access to Improved Water and Sanitation Facilities Program funded by DKH in order to improve the access to potable water and sanitation facilities to earthquak affected host communities in need in Ghoryan district of Herat province.

NCA is currently seeking a reputable, licensed suppliers for construction of water supply systems in the Zang-e-Saba village of the mentioned district of Herat province. The aim of this tender is to fix the prices of water supply schemes. The quantities and description will be provided in technical description part of this document.

### **Type of Services**

The services required under this RFQ is to provide NCA with construction of water supply systems containing bore wells with percussion or rotary drilling method according to the soil texture up to depth required and accepted by NCA engineer in charge, water reservoir, equipped with solar powered water supply system from bore wells to reservoir.

### **Scope of Work (SOW):**

The scope works for this RFQ is as bellow:

- Drilling of bore wells with technic according to the soil type of targeted villages with its development, casing, well testing for yield (mix discharge) and compressor test if required.
- Construction of RCC water reservoirs with the capacity as per drawing elevated reservoir in selected villages.
- Solar water pumping system to pump water from bore well to reservoirs with completer accessories stated in the specifications and drawings.
- Connector pipes with all connections.
- Training community maintenance workers for each water supply schemes

The works should be accomplished accordingly to specification and design given. Changes to be made in accordance with NCA technical engineer in charge and vivid reason and approval.

### **Protection:**

During the contract period, when work is not in progress, the boreholes shall be kept capped in such a manner as to prevent the entrance of foreign materials. The Contractor shall remove any excess matter at his own expense. The work to be done considering safety measures in place e.g. avoid child labour, explosive material and other practices with is not in line with OSHA (Occupational Safety and Health Administration) standards.

### **Visibility:**

All project sites shall be marked with at least one project sign board. The contractor has to ensure that the sign board will contain at least the following message:

“This project is financed by NCA and the Logo of the NCA and IP should be displayed. Additionally, the Logo of

**“Lost” (Unsuccessful) Borehole:**

The bore well can be considered as negative after confirmation of NCA technical engineer in charge and considering reasons below.

- A borehole having no water bearing zones/aquifers and confirmed from all stockholders.
- A Borehole that has insufficient discharge (less than 1.5 liters/second) for 8 hours of continuous pumping test.
- For any reasons, contractor is unable to continue drilling and complete the construction of borehole to the identified depth, then this borehole is deemed to be an “uncompleted” borehole.

In case of uncompleted (failed) boreholes due to the failure of the supplier, no payment shall be made for that borehole either for drilling or materials that cannot be salvaged, and the rig's unproductive time spent. If the Contractor chooses to deviate from standard procedure and the agreed method of drilling and wishes to adopt any other procedure or techniques that involves any additional cost and time required, it will be done so entirely at the Contractor's own risk and cost.

**Delivery date:**

Since the project nature is emergency, the contractors should try much to implement it in short period with the quality required. The implementation plans of contractors to be reviewed by technical committee of NCA and to be evaluated for project implementation.

**Project deliverable:**

The contractor is to submit deliverables required for project implementation and monitoring such as, water quality tests, yield test report progress review reports and slump test of Concrete and compressor test for bore well.

**Technical staff**

NCA requires supplier to have at least three staff dedicated to this project implementation comprises of a technical engineer ensuring quality and quantity of work, and one social workers ensuring social issues arising in the community. In the meantime, NCA staff will be in their support for technical and contextual issue.

**Monitoring and reporting**

The contractor should clarify report the progress of work every week to NCA engineer in charge. In the meantime, NCA stockholders specifically PRRD technical staff will have regular field visits for ensuring quality of the project. In case any problems arising, contractor should inform NCA immediately and to try to convince stockholder through community mobilizations skills. NCA will designate one of its staff to coordinate with the contractor to regularly monitor the drilling of borehole, construction process, and installation of items. NCA will undertake on-the-spot checks and monitoring of the progress and quality of the work. The contractor must inform NCA technical team from the project's milestones so that together with the contractor, NCA conducts the monitoring of the above-mentioned activities.

**Specification of Electricity Appliance.**

**Solar panels:** This project is containing solar panels made in Germany with Lorentz Solar or Grundfos Solvis brands or equivalent, the power of each of solar panels are 250-300 watt with range of abatements temperature 230-270 k and power tolerance 5-7 % with tilt angle 40-35 degree and MPPC= 9.5 Amir and 39.5 voltage of potential differentiate. The relevant Company and MRRD technical team should verify the solar panel to NCA technical engineer in charge prior to installation.

**Pipes and other electricity appliances.**

The project will include various types of pipes, including PE, PVC, and GI. Each type of pipe must be verified by the NCA technical team, and the necessary tests must be conducted on samples of each pipe prior to installation. Installation will proceed only after the test results meet the applicable national and international norms and standards. Please note that the taps and other water supply items selection is the authority of NCA technical team.

**Concrete.**

This project is designed based on ASTM standard and includes both PCC and RCC concrete, the steel bars for RCC is made in Tashkent with grade 60 and yield 60 kg per square centimetre or Khan steel with the same specifications. The mixing methodology of concrete must be by mixer machine based on mix design considering local strengthen of concrete materials. The praprted concrete must be used within 30 min and after it would be expired and not allowed to use. The mix design should be by MANAK and by weight of gravel, Sand, cement and water.

The materials used in concrete shall be proportionate by weight following the standard cement/sand/aggregate mix ratios as follows: -

For reinforced concrete mix - 1:1:2 mix ratio only for footing and columns –

For reinforced concrete mix - 1:1.5:3 mix ratio for beams, slab, and peaks. –

For plain/mass concrete mix - 1:1.5:3 mix ratio –

For brick masonry mortar mix- 1:4 Mix ratio –

For plastering mortar mix- 1: 2 Mix ratio –

For stone masonry mortar mix- 1:3 Mix ratio The aggregates mix, cement, and water content ratio shall be selected to obtain the best results for compressive strength, density, water tightness & durability, workability, and finish quality. The concrete mix must be such that the design is compatible with the minimum water content ratio to give each grade adequate concrete workability.

The grades of concrete for the various works shall be as noted on the drawings and as below: C25: all reinforced concrete (foundations, slabs, etc.) - Characteristics compressive strength at 28days: 250kg/cm - Minimum cement content: 280 kg/m - Max free water content ratio: 0.40 - Max nominal size of aggregates: 25mm After placement, the concrete shall be vibrated by mechanical means. The vibration method is to be approved by the WASH Site Engineer/works personnel before the operation. The vibrated and consolidated concrete is finished by toweling or floating the surface to a smooth and flat finish. Following placement, vibration, and finishing work to the concrete and after the initial set has occurred not to damage the surface of the concrete, appropriate measures, approved by the site Engineer/Works personnel are to be implemented to cure the concrete for a minimum period of 14 days. Where concrete previously placed as part of the works is to be butted, jointed, or raised with the addition of further concrete, except in the case where the initial concrete is blinding concrete, the

first concrete surface must be suitably prepared by the scrabbling, i.e., removing the laitance (fine concrete surfacing) before placement of the other concrete. The method is to be approved by the Site Engineer/Works personnel. After scrabbling, the concrete shall be a thoroughly wetted and thin layer of 1:2 cement: sand mortar applied before pouring the new concrete. Steel reinforcement shall be positioned with a clearance or 40mm to the face of the concrete unless otherwise directed by the Engineer/Works personnel or shown in the Contract drawings. Formwork for the concrete shall be to the approval of the NCA Engineer and shall not allow grout loss from the concrete mix. Prior to the concrete placement, the formwork is to be inspected and all harmful materials removed to the approval of the NCA WASH Engineer/Works personnel. The Contractor must undertake no mixing or placement of concrete without prior permission by the NCA WASH Engineer.

Steel reinforcement shall be the correct diameter, as shown on the drawings. The bars shall be clean and free from rust. They shall be securely fixed with wire before placing the concrete. The minimum cover to reinforcement shall be 25mm

Once mixed, concrete shall be used immediately. Any concrete, which had been allowed to achieve its initial set, shall not be placed. Concrete shall be placed in layers with a maximum thickness of 250mm. Each layer shall be properly compacted with a vibrator or at least by a wooden (or any other) rammer. When placing on old or set concrete, the surface of the old concrete shall be thoroughly cleaned and wetted with water. If the surface is smooth, it must be chipped to form a suitable key. Old concrete shall be painted with liquid cement prior to placing new concrete.

Sufficient water is required for concrete to harden through hydration. The concrete must be kept moist or "cured" to ensure that it does not dry out. Poorly cured concrete will shrink or crack, and not achieve its full strength. Concrete shall be cured by covering in plastic sheets. Spraying with water, covering with wet Sand, or other methods proposed by the Contractor and approved by the Engineer. The Contractor shall ensure that all concrete is adequately cured. Curing shall start as soon as the concrete has been poured and shall continue until curing is complete after 28 days. otherwise, the concrete will be rejected, and all the main and associated costs would be on contractor.

**Cement.**

Fresh Cement (Cherat-Portland 400 or 500) shall be delivered to the site in prime powder form and sealed bags. It shall be kept clean and dry until usage. Partially used bags of cement shall be stored in a dry place until required. Any partially used bags, which have become damp, shall be rejected. The Contractor will store the empty bags for the NCA technical team count and dispose of them by the Contractor.

**Bricks.**

Shall be obtained from an approved source and of uniform color, size (10\*11\*22) cm, and shape. Bricks shall have smooth rectangular faces with sharp straight, right-angle edges. Maximum absorption shall not be more than 15% of its dry weight on immersion in water for 24 hours. Minimum crushing strength shall be 140 kg/cm<sup>2</sup>.

**Stone:**

Stone shall be hard, sound, free from decay and weathering. Stones with porous matter or with boulder skin shall be rejected. The size of stones shall not be less than 15cm in any direction. Cement and sand for cement mortar shall be of standard specification.

**Safety.**


The contractor should provide sufficient safety measures for skilled and unskilled labors and other hired workers on the Project site, the contractor should provide all required PPEs (personal protection equipment) to their workers and labors such as Safety glasses, Safety shoes, safety helmet cap, Gloves, and safety vest coat. If a labor injured/died in time of work in the project all the responsibilities go to the company and NCA doesn't have any responsibility in it at any case.

**Frames/Ing.**

Frames should be from new and smooth surface plywood with no cracks or dots in it (NO PLYWOOD IS ALLOWED TO BE REUSED). During framing rotary metallic stands should be used and no wooden pole stanchion is allowed due to construction norms and safety issues. It is worth mentioning that in case breaching any construction rules in framing no paid of frames should be made to the contractor.



**Quality of works & Technical specification:**



Full specifications can be found as ANNEXES: NCA will not accept any items of construction bellow than specifications provided under Annex. NCA will evaluate monitoring and evaluate activities based on international standard through inspection, verification and testing. Its mentionable, that any changes in the specification should be made in accordance with NCA technical team instructions and agreement.

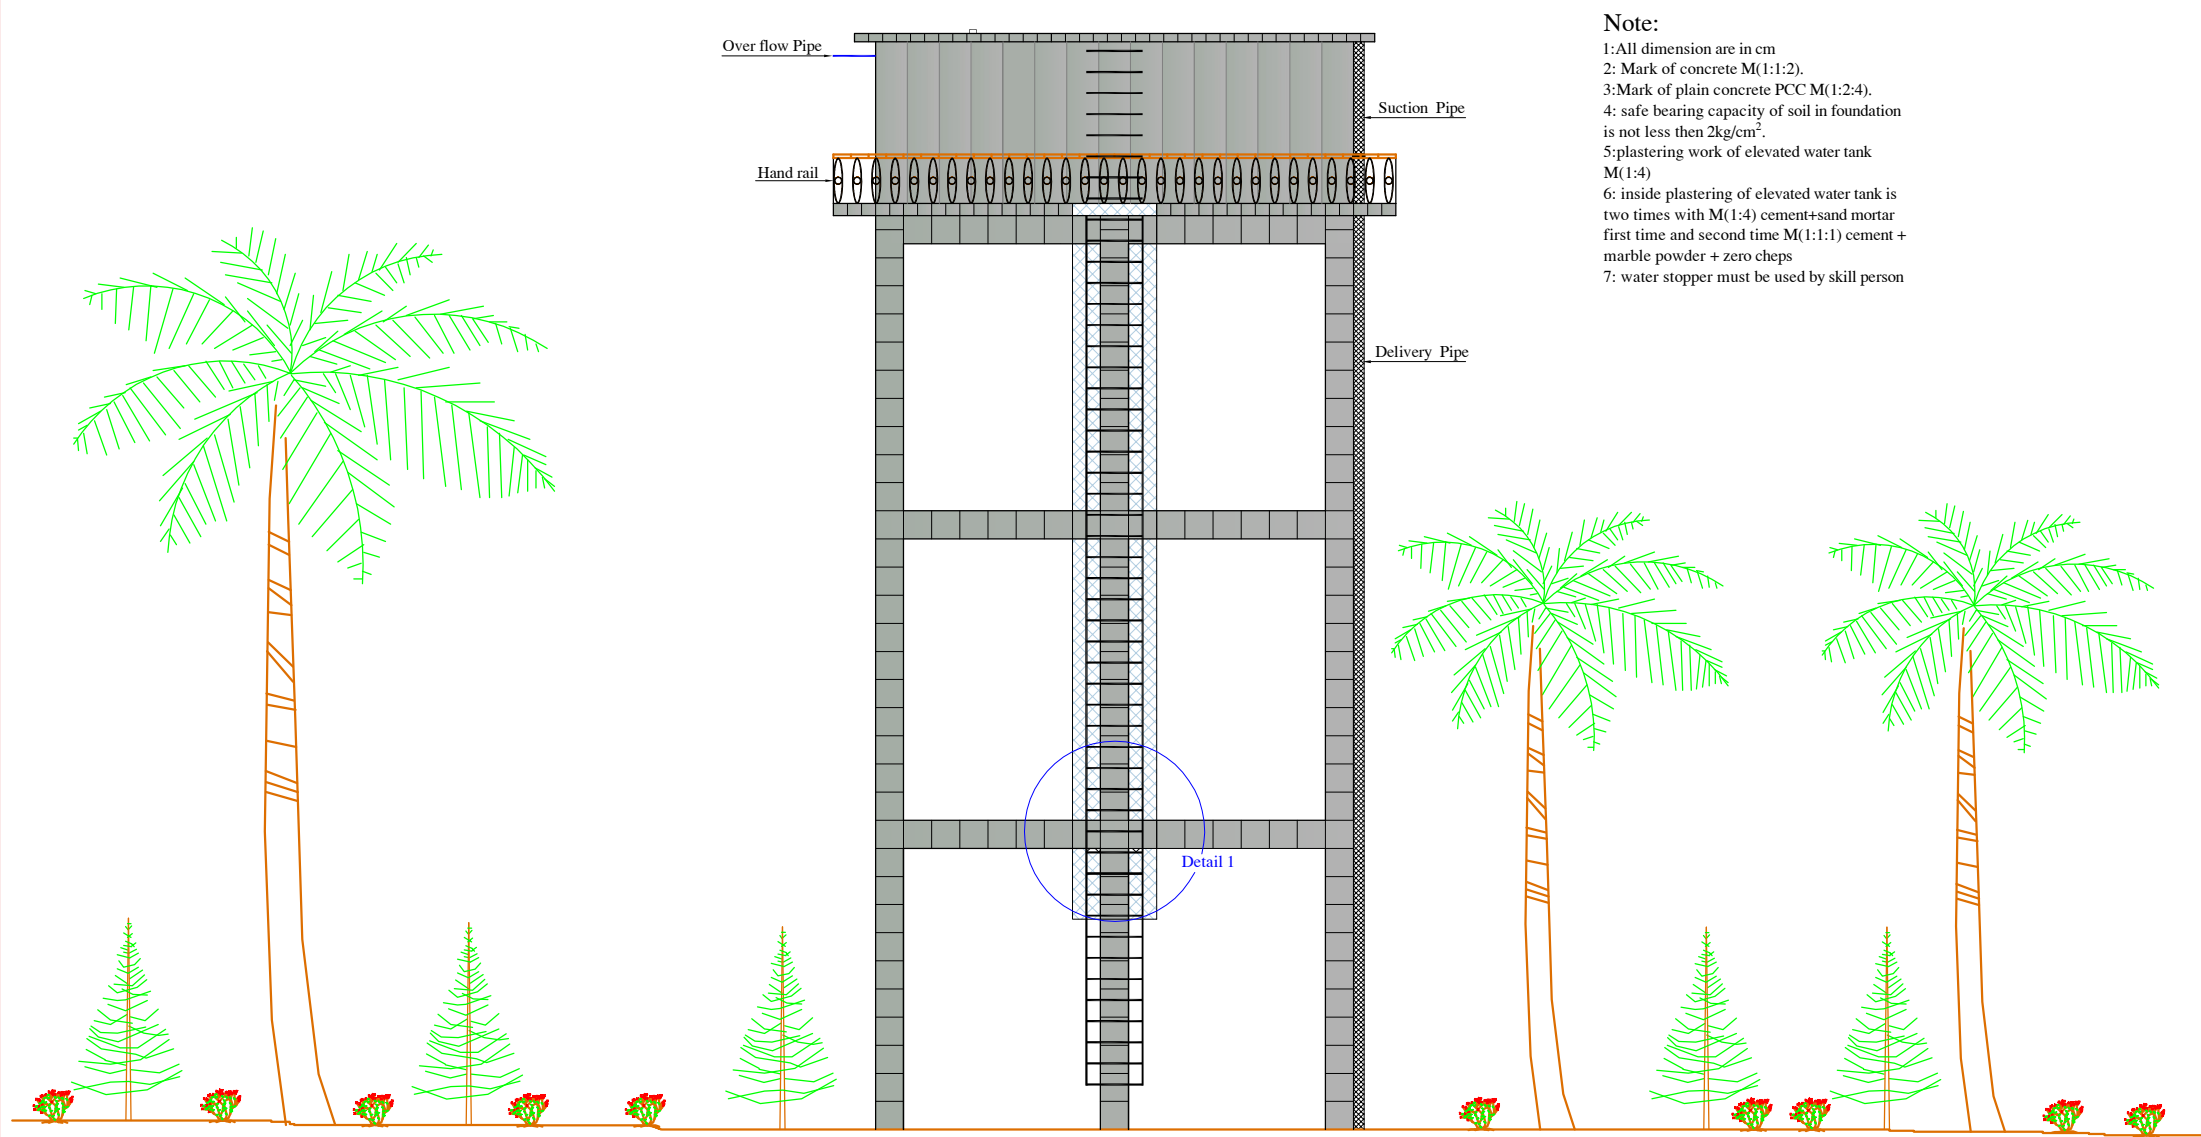

- Note:**
- 1: All dimension are in cm
  - 2: Mark of concrete M(1:1:2).
  - 3: Mark of plain concrete PCC M(1:2:4).
  - 4: safe bearing capacity of soil in foundation is not less then 2kg/cm<sup>2</sup>.
  - 5: plastering work of elevated water tank M(1:4)
  - 6: inside plastering of elevated water tank is two times with M(1:4) cement+ sand mortar first time and second time M(1:1:1) cement + marble powder + zero cheps
  - 7: water stopper must be used by skill person


Elevation of Water Tank Tower


	NCA AFGHANISTAN	SURVEYED BY	Eng. Zar Mohammad Ahmadzai	CHECKED BY	Eng. Farhad Aaqeb	SCALE		SHEET NO. 	PROVINCE	Herat	PROJECT NAME	Water Supply Project
		DESIGNED BY	Eng. Zar Mohammad Ahmadzai	REVIEWED BY	Eng. Farhad Aaqeb	DATE	29/09/2024		DISTRICT	Ghoorian	DRAWING TITLE	
		DRAWN BY	Eng. Zar Mohammad Ahmadzai	APPROVED BY	Eng. Farhad Aaqeb	DRAWING NO.			VILLAGE	Zangi Saba		40 m3 Elevated water reservoir front view

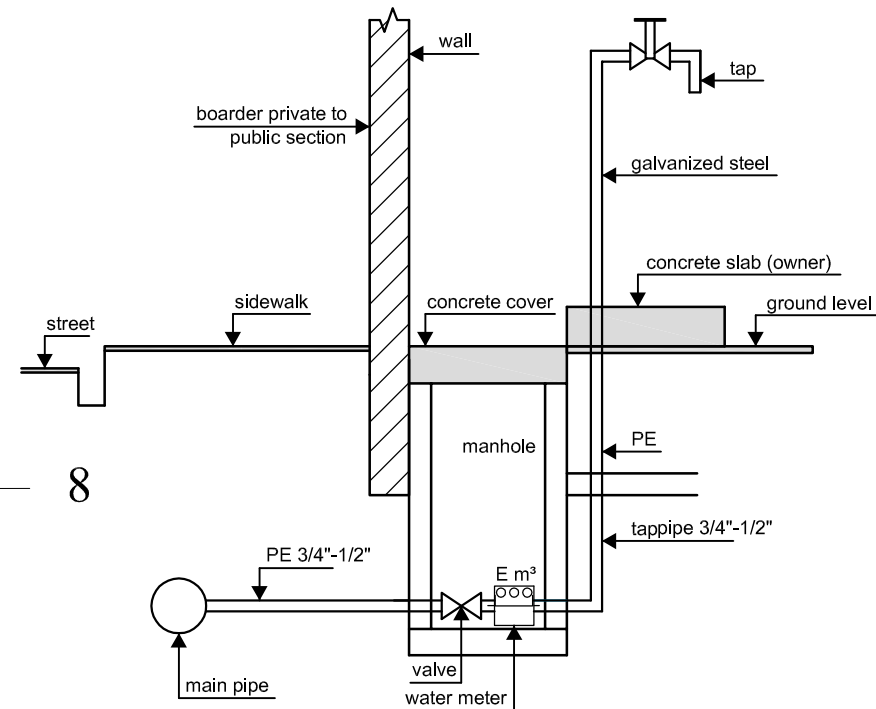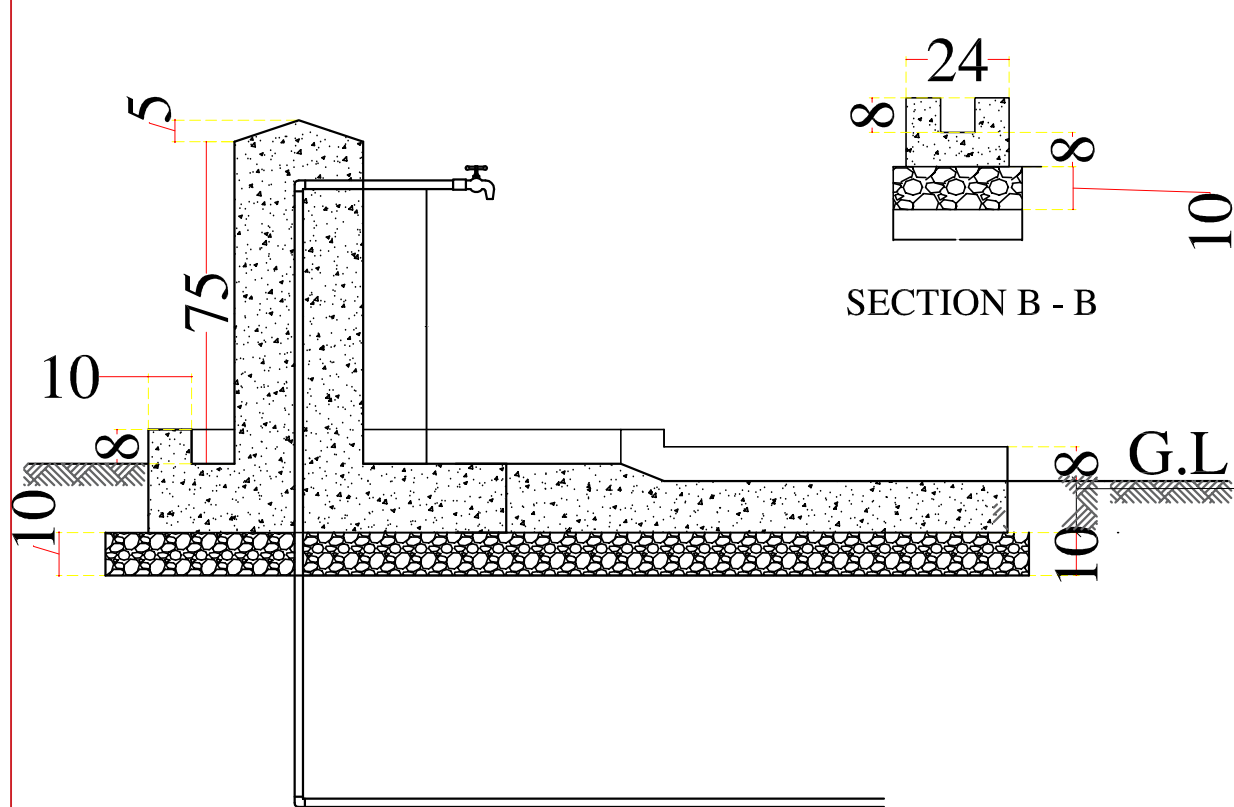

SECTION A - A



HOUSE CONNECTION DETAIL

 <p>NCA AFGHANISTAN</p>	SURVEYED BY	Eng. Zar Mohammad Ahmadzai	CHECKED BY	Eng. Farhad Aaqeb	SCALE		<p>SHEET NO.</p> <p>10/14</p>	PROVINCE	Herat	PROJECT NAME		Water Supply Project
	DESIGNED BY	Eng. Zar Mohammad Ahmadzai	REVIEWED BY	Eng. Farhad Aaqeb	DATE	29/09/2024		DISTRICT	Ghoorian	DRAWING TITLE		Stand Tap Plan
	DRAWN BY	Eng. Zar Mohammad Ahmadzai	APPROVED BY	Eng. Farhad Aaqeb	DRAWING NO.			VILLAGE	Zangi Saba			

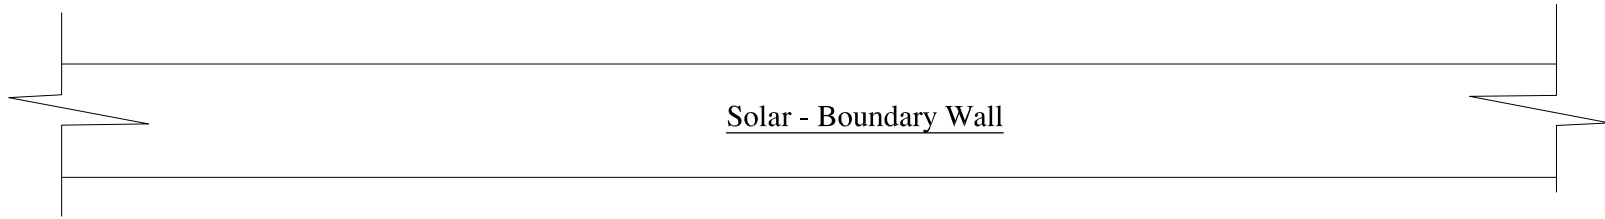


Solar - Boundary Wall

A

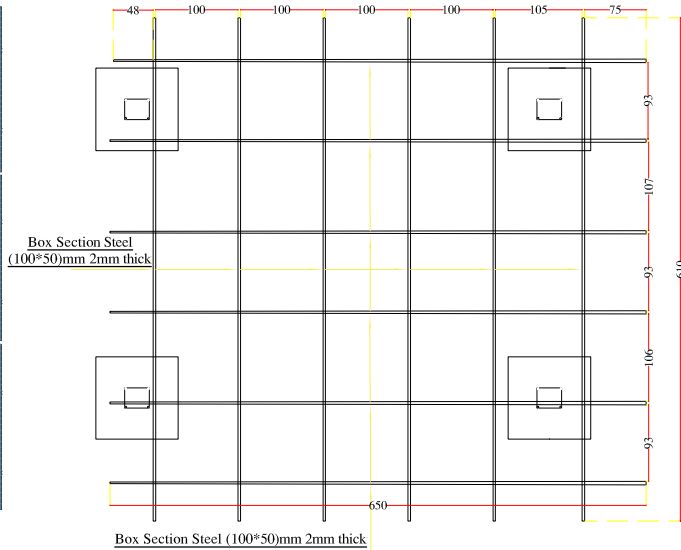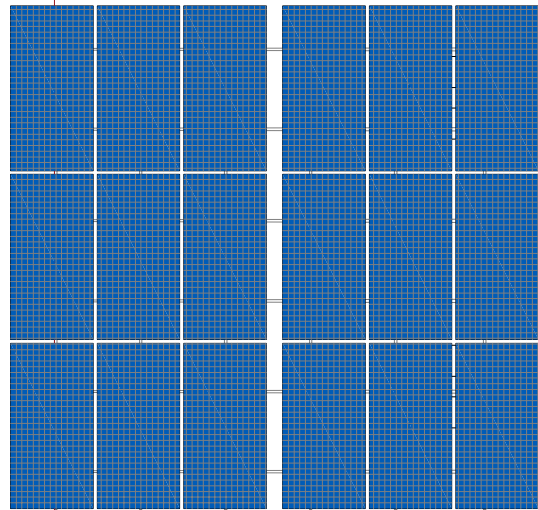


Solar Panels Frame Plan

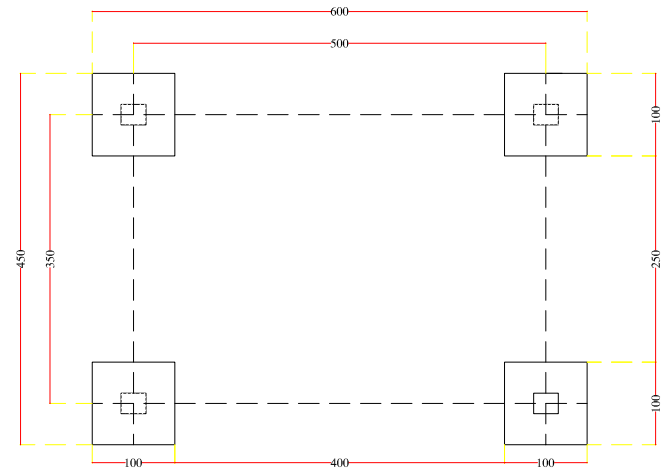



Footing plan for Solar Panels

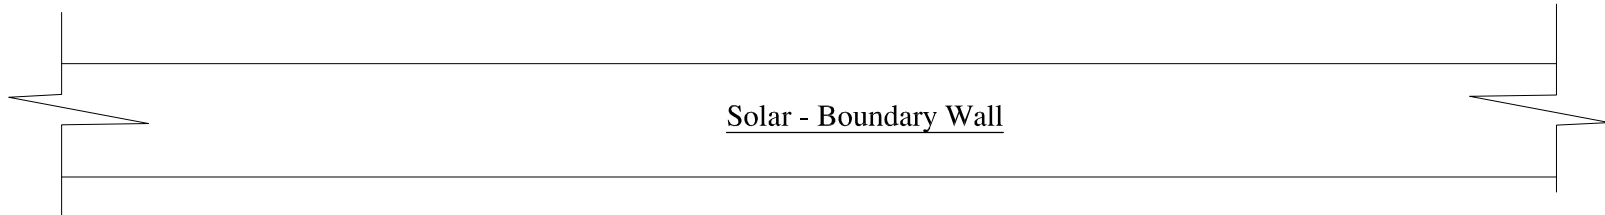A




Solar - Boundary Wall

 <b>NCA</b>	NCA	SURVEYED BY	Eng. Zar Mohammad Ahmadzai	CHECKED BY	Eng. Farhad Aaqeb	SCALE			PROVINCE	Herat	PROJECT NAME	Water Supply Project
	AFGHANISTAN	DESIGNED BY	Eng. Zar Mohammad Ahmadzai	REVIEWED BY	Eng. Farhad Aaqeb	DATE	29/09/2024		DISTRICT	Ghoorian	DRAWING TITLE	Solar Panel Footing Plan
		DRAWN BY	Eng. Zar Mohammad Ahmadzai	APPROVED BY	Eng. Farhad Aaqeb	DRAWING NO.			VILLAGE	Zangi Saba		







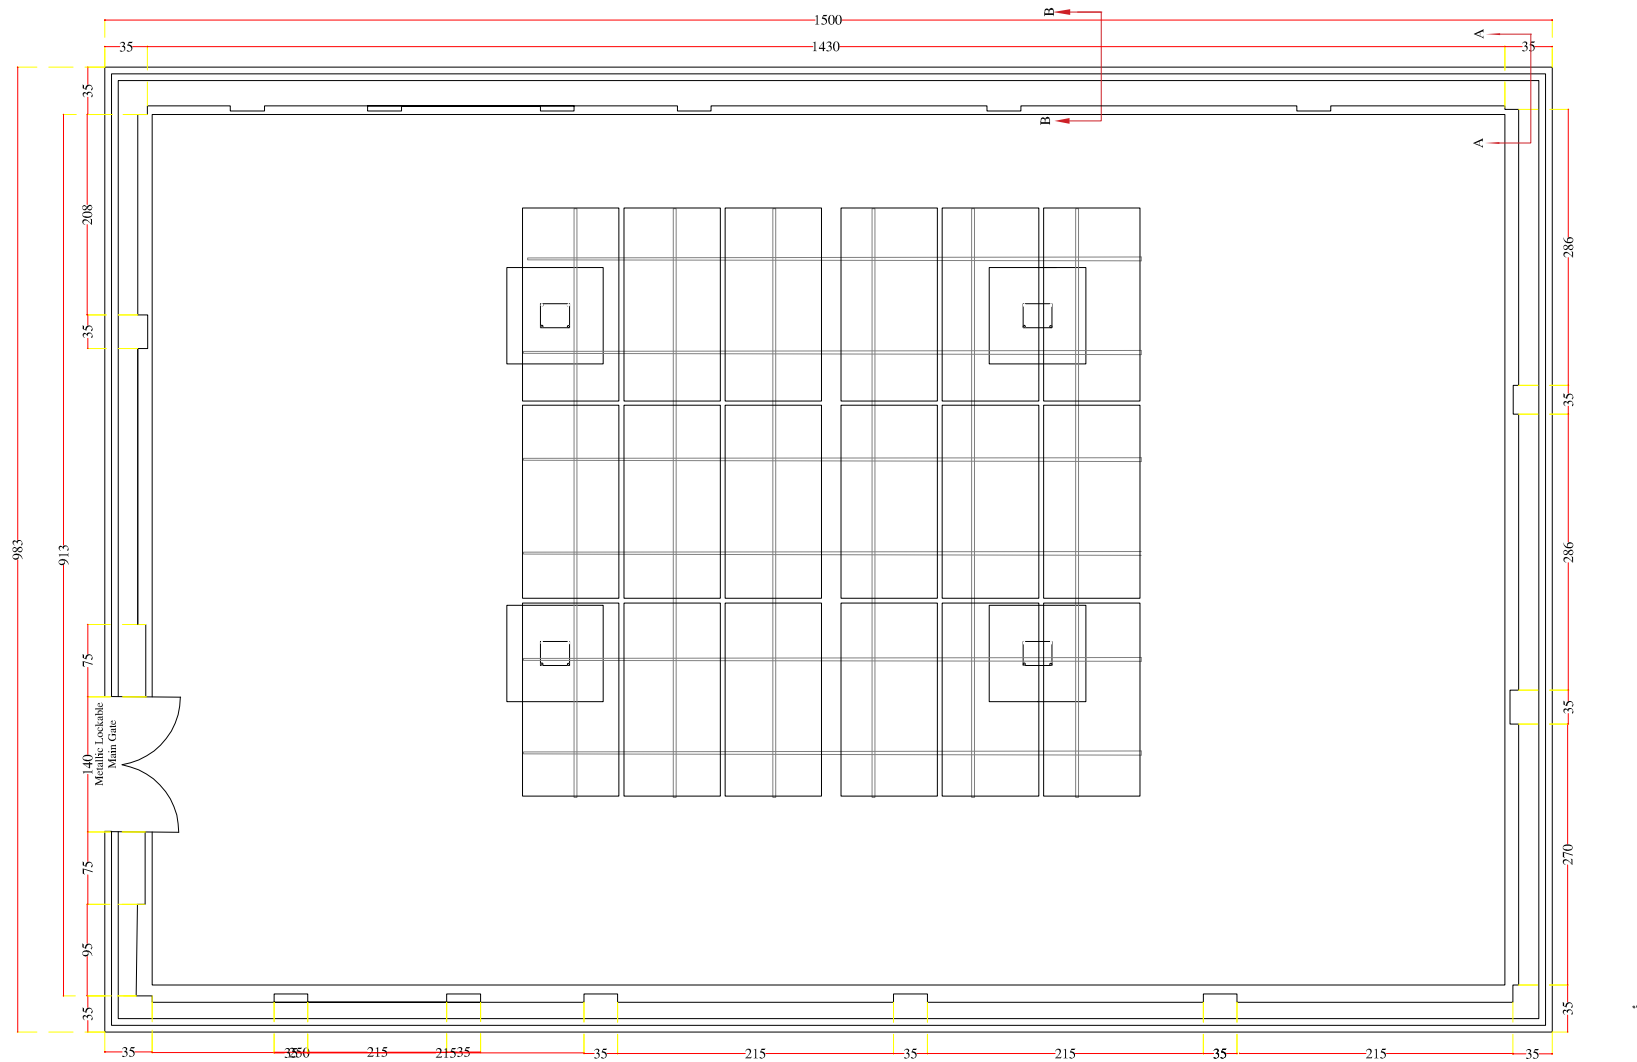


### Note:


1. all dimensions are in cm unless otherwise stated.
2. During RCC works vibrator must be used to avoid from segregation in concrete.
3. All PCC works should be with M200 mortar
4. All RCC works should be with 250 mortar
5. Brick Masonry (1:4)
6. curing must be continued up to 28 days
7. clear and clean water must be used
8. The exact location and direction of Solar boundary wall should be adjust as per site condition .

### Boundary wall for 18 PCs Solar panels


 NCA AFGHANISTAN	SURVEYED BY	Eng. Zar Mohammad Ahmadzai	CHECKED BY	Eng. Farhad Aaqeb	SCALE	Concertina see Detail 1	 SHEET NO. 13/14	PROVINCE	Herat	PROJECT NAME	Water Supply Project
	DESIGNED BY	Eng. Zar Mohammad Ahmadzai	REVIEWED BY	Eng. Farhad Aaqeb	DATE	29/09/2024		DISTRICT	Ghoorian	DRAWING TITLE	Boundry Wall for 18 Solar Panels
	DRAWN BY	Eng. Zar Mohammad Ahmadzai	APPROVED BY	Eng. Farhad Aaqeb	DRAWING NO.			VILLAGE	Zangi Saba		

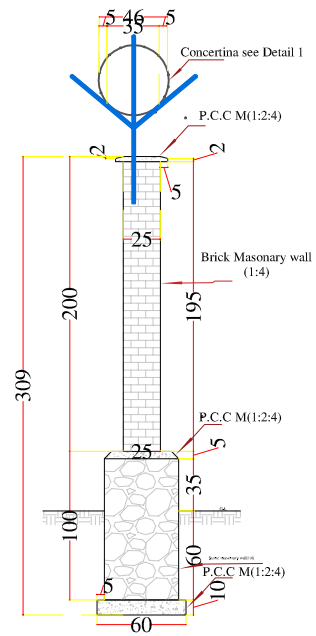


**Section B-B**

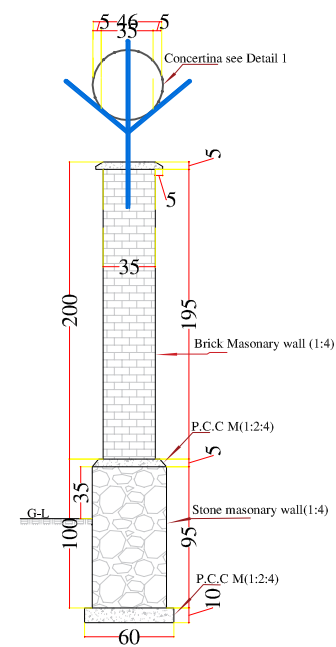


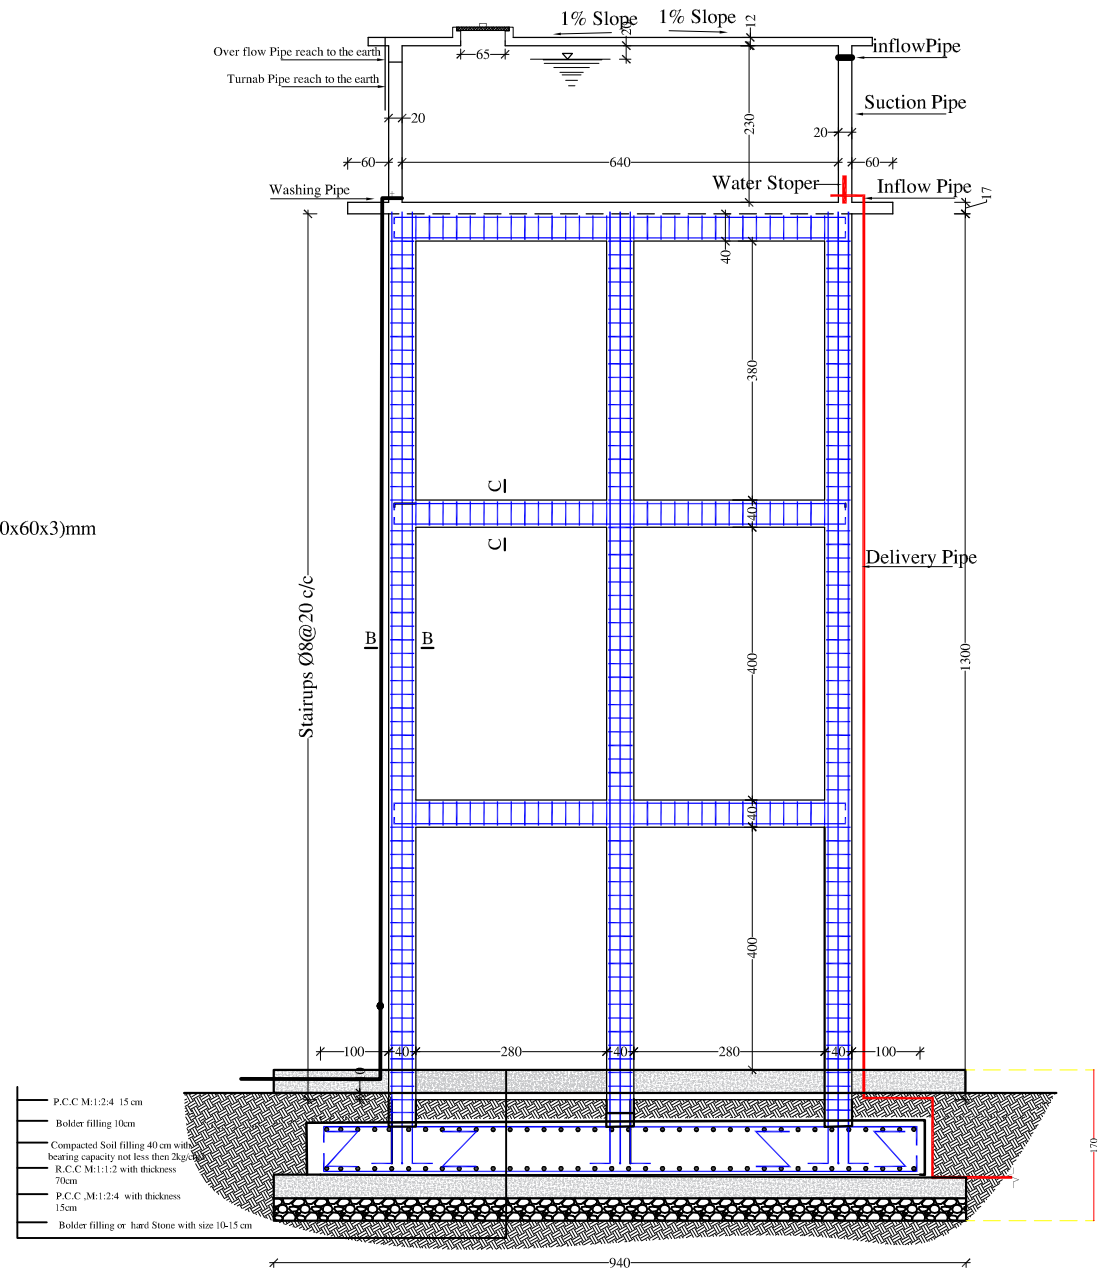
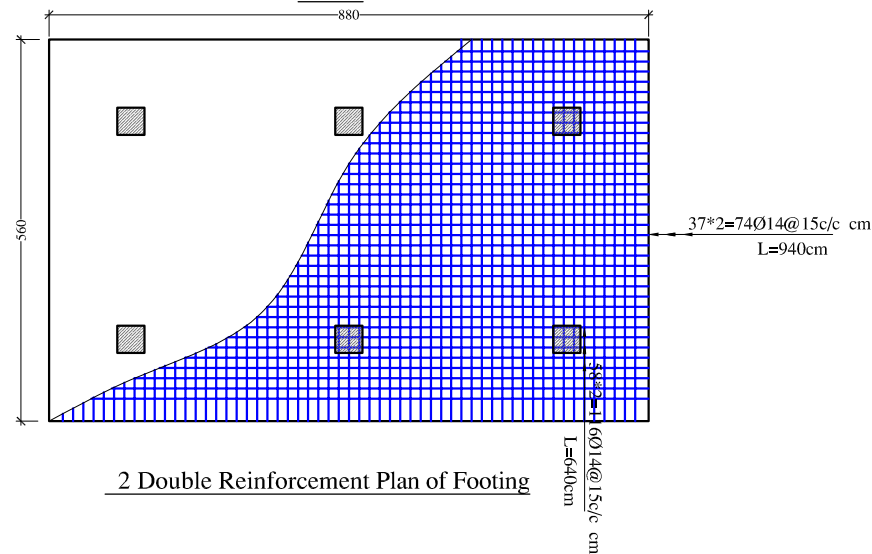
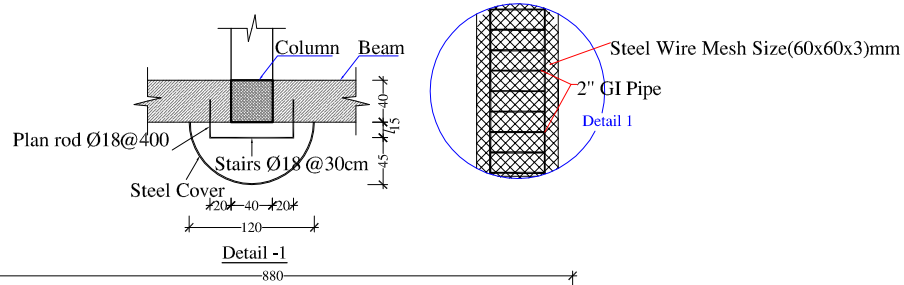
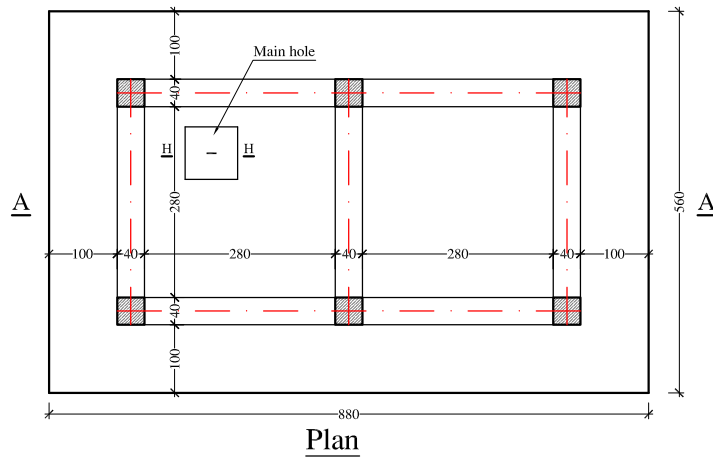
**Section A-A**

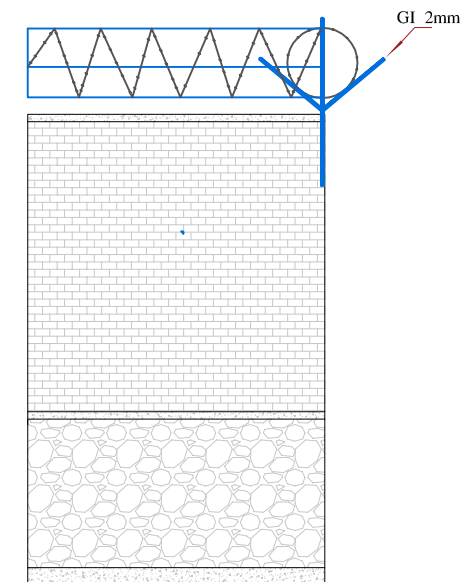

Galvanized for concertina fixation

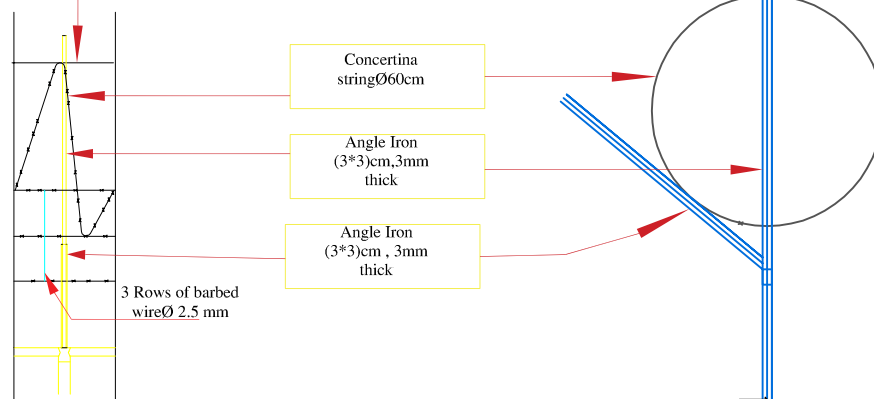

 <p>NCA AFGHANISTAN</p>	SURVEYED BY	Eng. Zar Mohammad Ahmadzai	CHECKED BY	Eng. Farhad Aaqeb	SCALE		<p>SHEET NO.</p> <p>14/14</p>	PROVINCE	Herat	PROJECT NAME	Water Supply Project
	DESIGNED BY	Eng. Zar Mohammad Ahmadzai	REVIEWED BY	Eng. Farhad Aaqeb	DATE	29/09/2024		DISTRICT	Ghoorian	DRAWING TITLE	Solar Panel Footing
	DRAWN BY	Eng. Zar Mohammad Ahmadzai	APPROVED BY	Eng. Farhad Aaqeb	DRAWING NO.			VILLAGE	Zangi Saba	Plan	SECTION A-A



NCA  
AFGHANISTAN

SURVEYED BY  
Eng. Zar Mohammad Ahmadzai

DESIGNED BY  
Eng. Zar Mohammad Ahmadzai

DRAWN BY  
Eng. Zar Mohammad Ahmadzai

CHECKED BY  
Eng. Farhad Aaqeb

REVIEWED BY  
Eng. Farhad Aaqeb

APPROVED BY  
Eng. Farhad Aaqeb

SCALE

DATE  
29/09/2024

DRAWING NO.

SHEET NO.  
2/14


PROVINCE  
Herat

DISTRICT  
Ghoorian


VILLAGE  
Zangi Saba

PROJECT NAME  
**Water Supply Project**


DRAWING TITLE  
40 m3 Elevated water reservoir

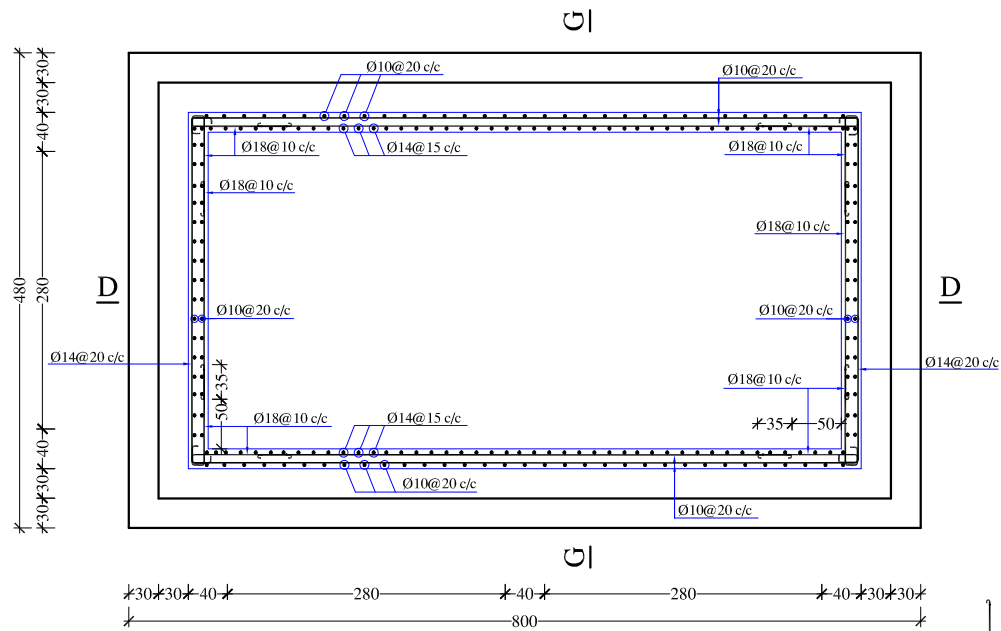


Reinforcement Plan of Water Tank

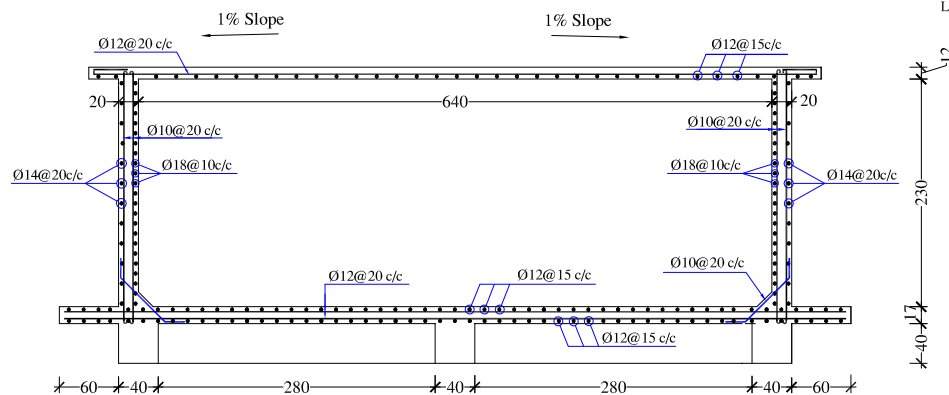



Section D-D

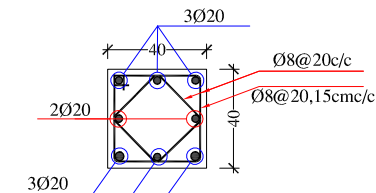


Section B-B



Section C-C

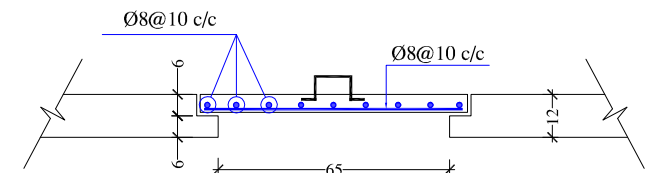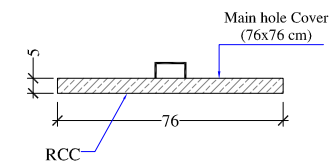




Section H-H

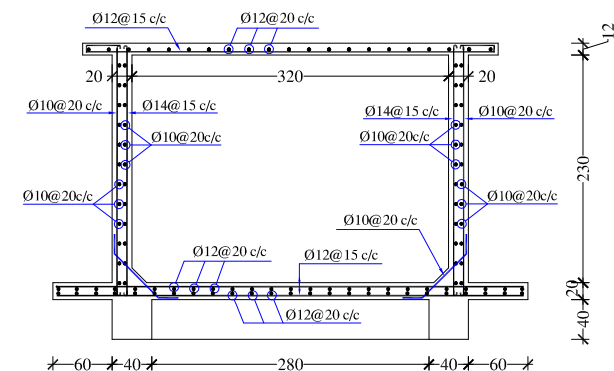


Section G-G

Corner Steel Bar Ø12 @10 c/c  
L=250cm


	NCA	SURVEYED BY	Eng. Zar Mohammad Ahmadzai	CHECKED BY	Eng. Farhad Aaqeb	SCALE			PROVINCE	Herat	PROJECT NAME	Water Supply Project
	AFGHANISTAN	DESIGNED BY	Eng. Zar Mohammad Ahmadzai	REVIEWED BY	Eng. Farhad Aaqeb	DATE	29/09/2024		DISTRICT	Ghoorian	DRAWING TITLE	40 m3 Elevated water reservoir
		DRAWN BY	Eng. Zar Mohammad Ahmadzai	APPROVED BY	Eng. Farhad Aaqeb	DRAWING NO.			VILLAGE	Zangi Saba		

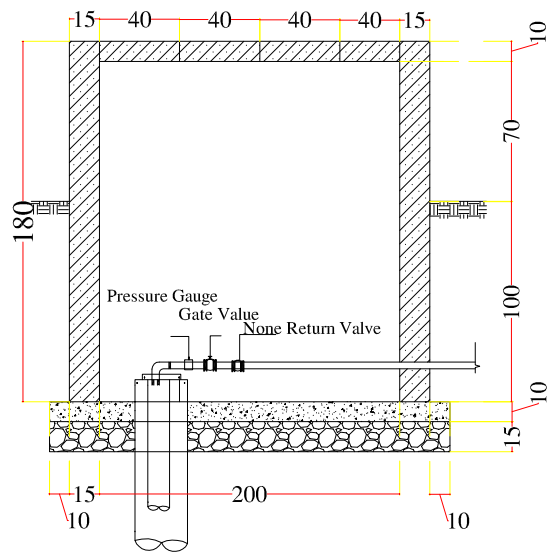


B-B Section

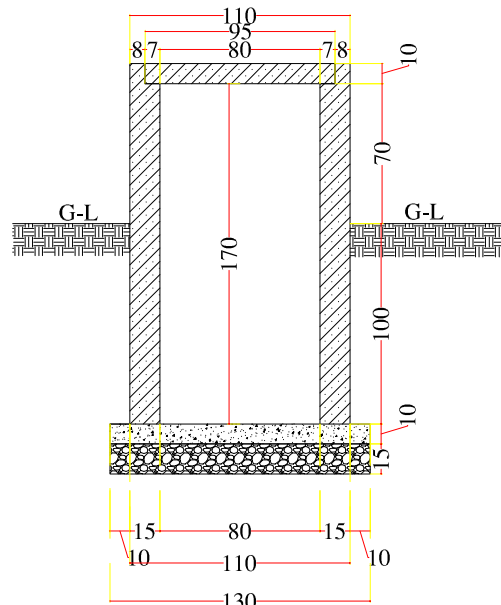


A-A Section

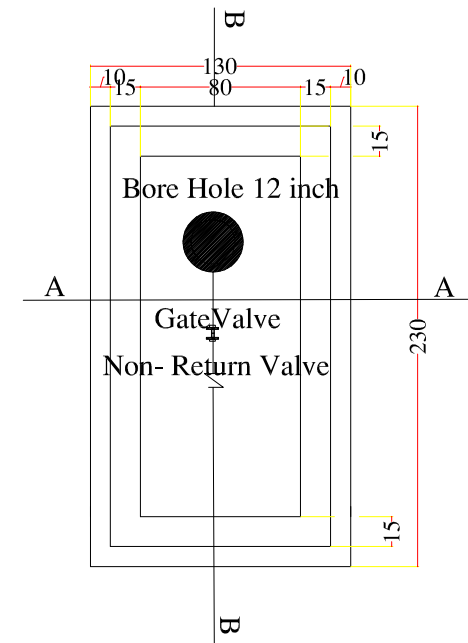


well Protection plan

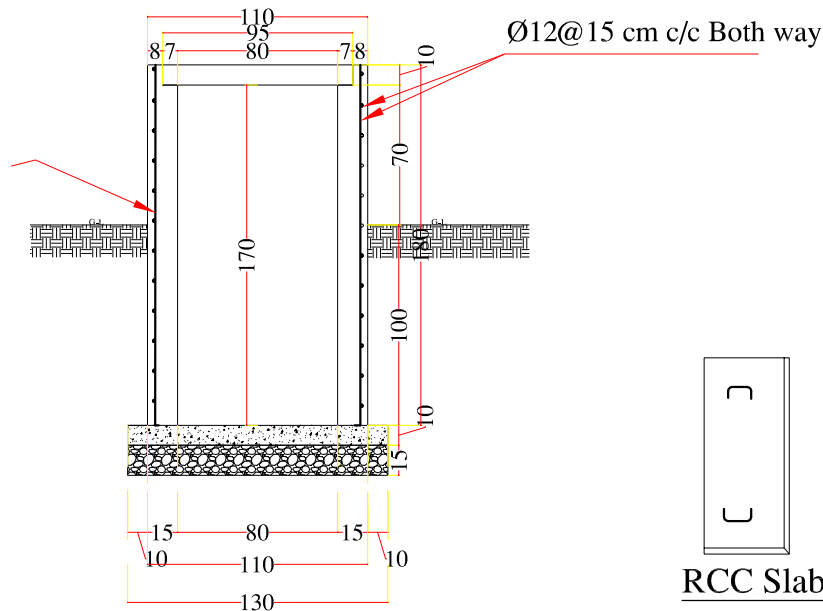

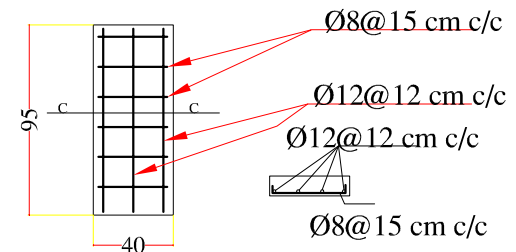

Wall Reinforcement




C-C Section




RCC Slab

	NCA	SURVEYED BY	Eng. Zar Mohammad Ahmadzai	CHECKED BY	Eng. Farhad Aaqeb	SCALE			PROVINCE	Herat	PROJECT NAME	Water Supply Project
	AFGHANISTAN	DESIGNED BY	Eng. Zar Mohammad Ahmadzai	REVIEWED BY	Eng. Farhad Aaqeb	DATE	29/09/2024		DISTRICT	Ghoorian	DRAWING TITLE	Well Protection Plan & Sections
		DRAWN BY	Eng. Zar Mohammad Ahmadzai	APPROVED BY	Eng. Farhad Aaqeb	DRAWING NO.			VILLAGE	Zangi Saba		





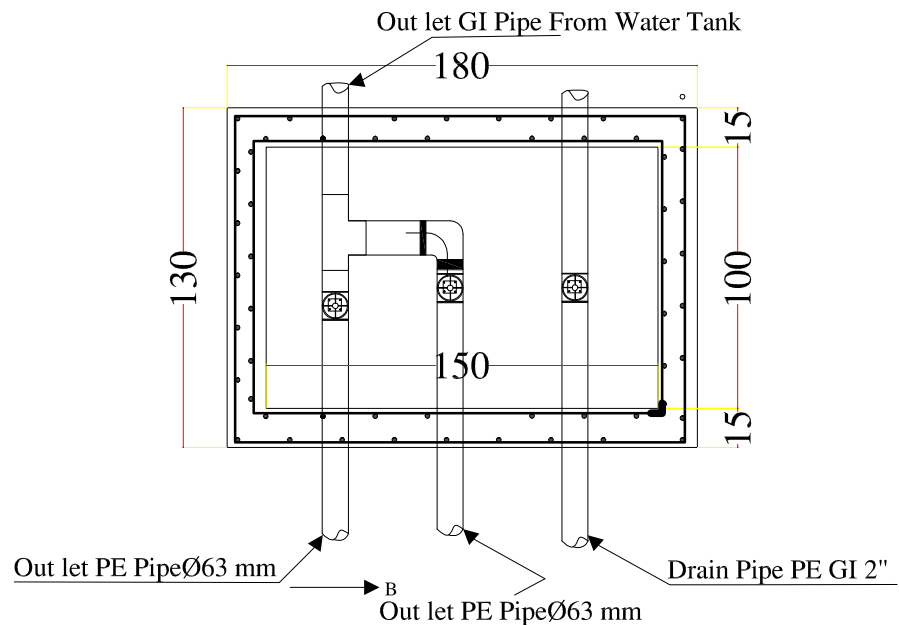

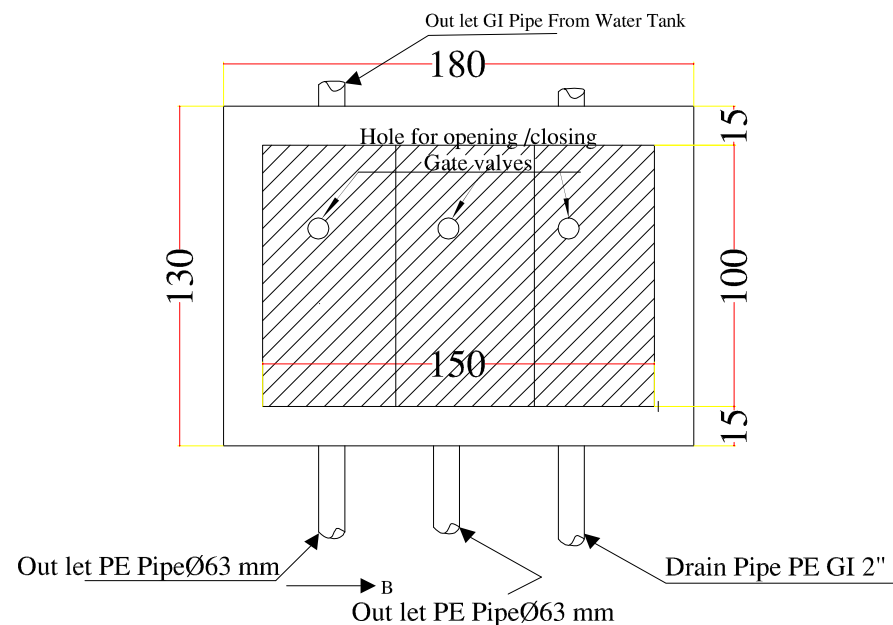

Section Plan of RCC WALL

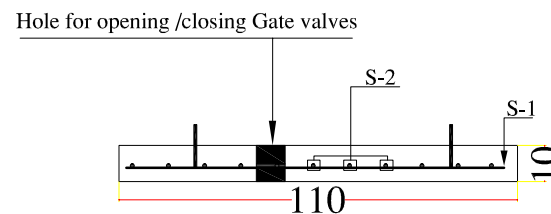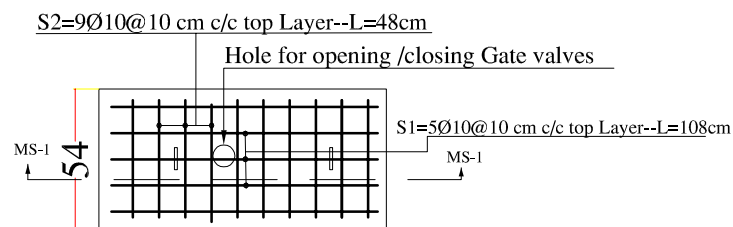







TOP VIWE





Section MS1-MS1


 NCA AFGHANISTAN	SURVEYED BY	Eng. Zar Mohammad Ahmadzai	CHECKED BY	Eng. Farhad Aaqeb	SCALE		SHEET NO. 	PROVINCE	Herat	PROJECT NAME <i>Water Supply Project</i>
	DESIGNED BY	Eng. Zar Mohammad Ahmadzai	REVIEWED BY	Eng. Farhad Aaqeb	DATE	29/09/2024		DISTRICT	Ghoorian	
	DRAWN BY	Eng. Zar Mohammad Ahmadzai	APPROVED BY	Eng. Farhad Aaqeb	DRAWING NO.			VILLAGE	Zangi Saba	DRAWING TITLE <i>Valve Box wall (R.C.C) Top view and Sections</i>

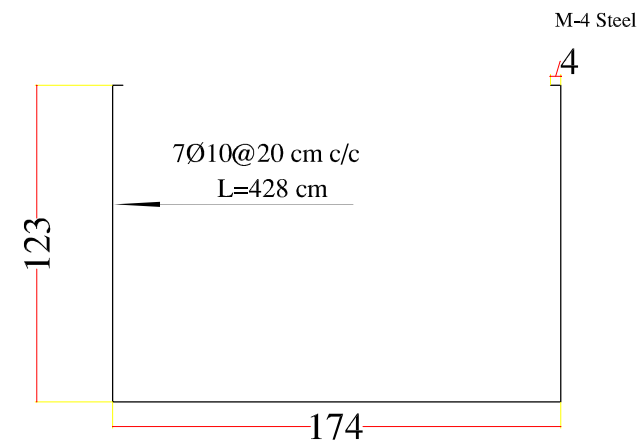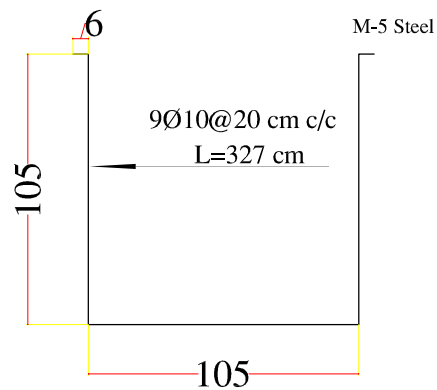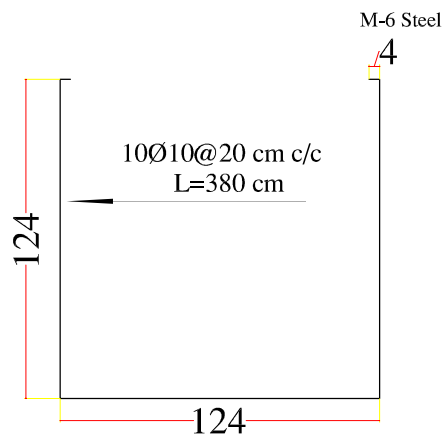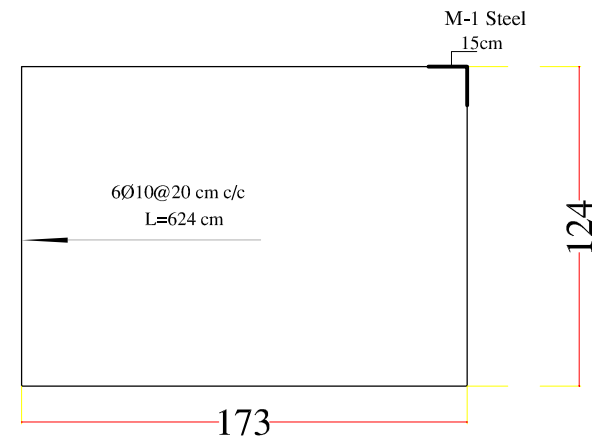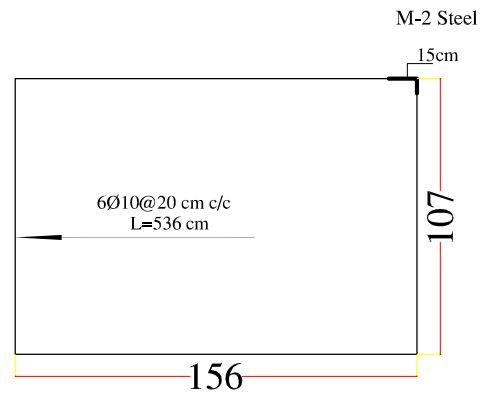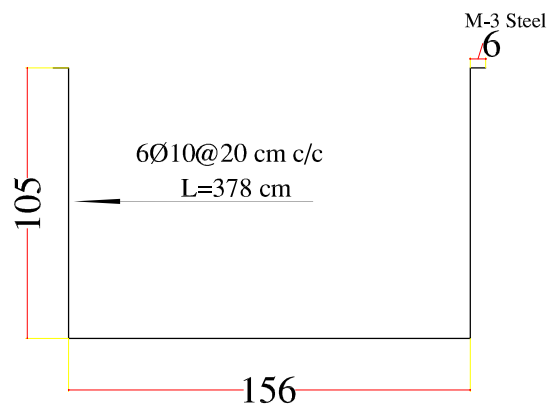




 NCA AFGHANISTAN	SURVEYED BY	Eng. Zar Mohammad Ahmadzai	CHECKED BY	Eng. Farhad Aaqeb	SCALE		SHEET NO. 	PROVINCE	Herat	PROJECT NAME <i>Water Supply Project</i>	
	DESIGNED BY	Eng. Zar Mohammad Ahmadzai	REVIEWED BY	Eng. Farhad Aaqeb	DATE	29/09/2024		DISTRICT	Ghoorian	DRAWING TITLE <i>Gate Valve Box R.C.C Section</i>	
	DRAWN BY	Eng. Zar Mohammad Ahmadzai	APPROVED BY	Eng. Farhad Aaqeb	DRAWING NO.			VILLAGE	Zangi Saba		


# GATE VALVE BOX

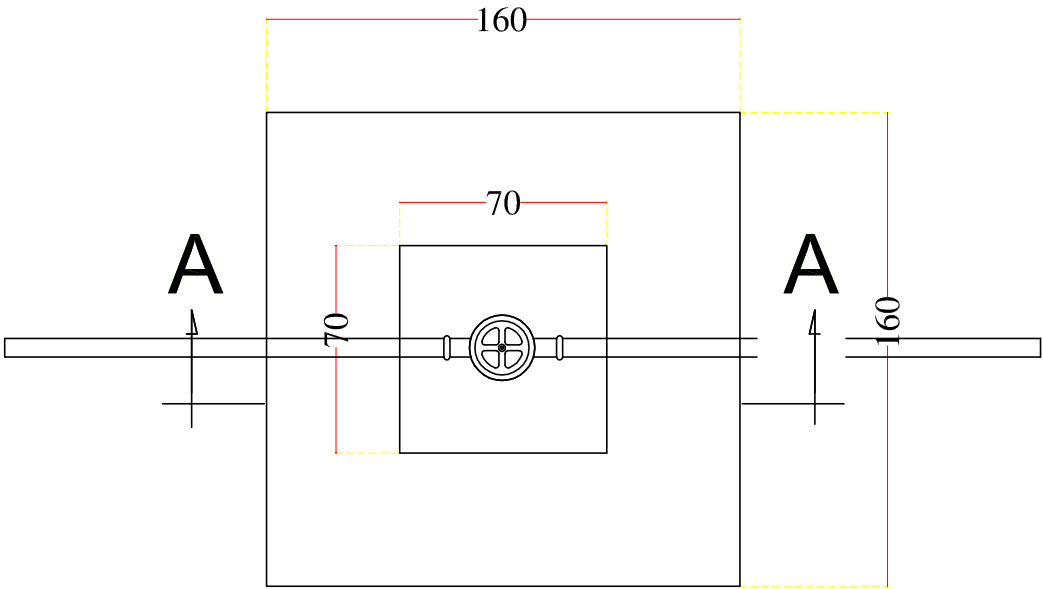

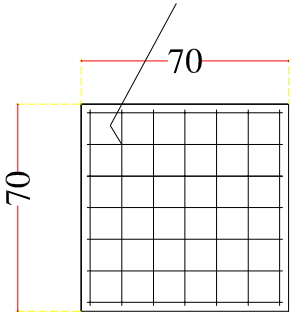

14 6mm L = 66 Cm

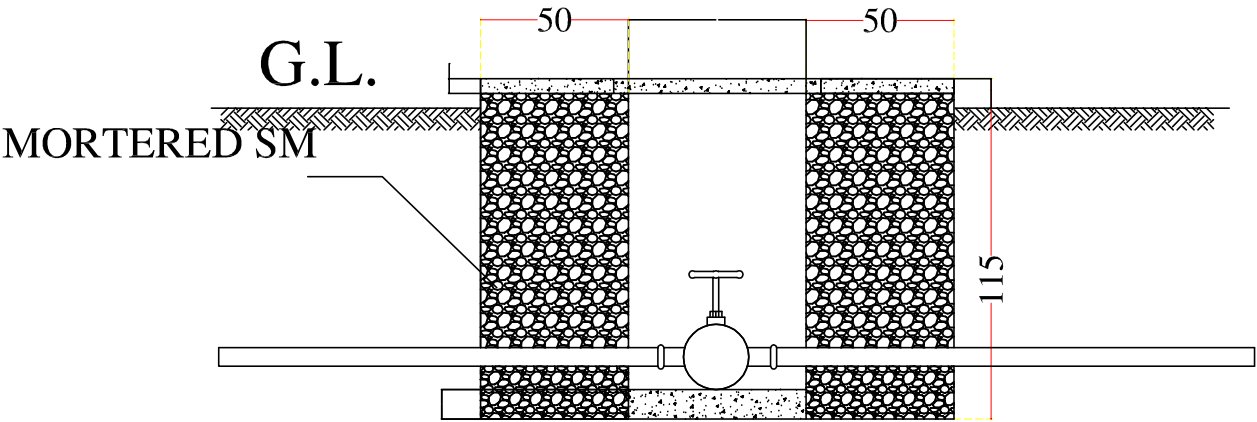


COVER PLATE





SECTION A - A

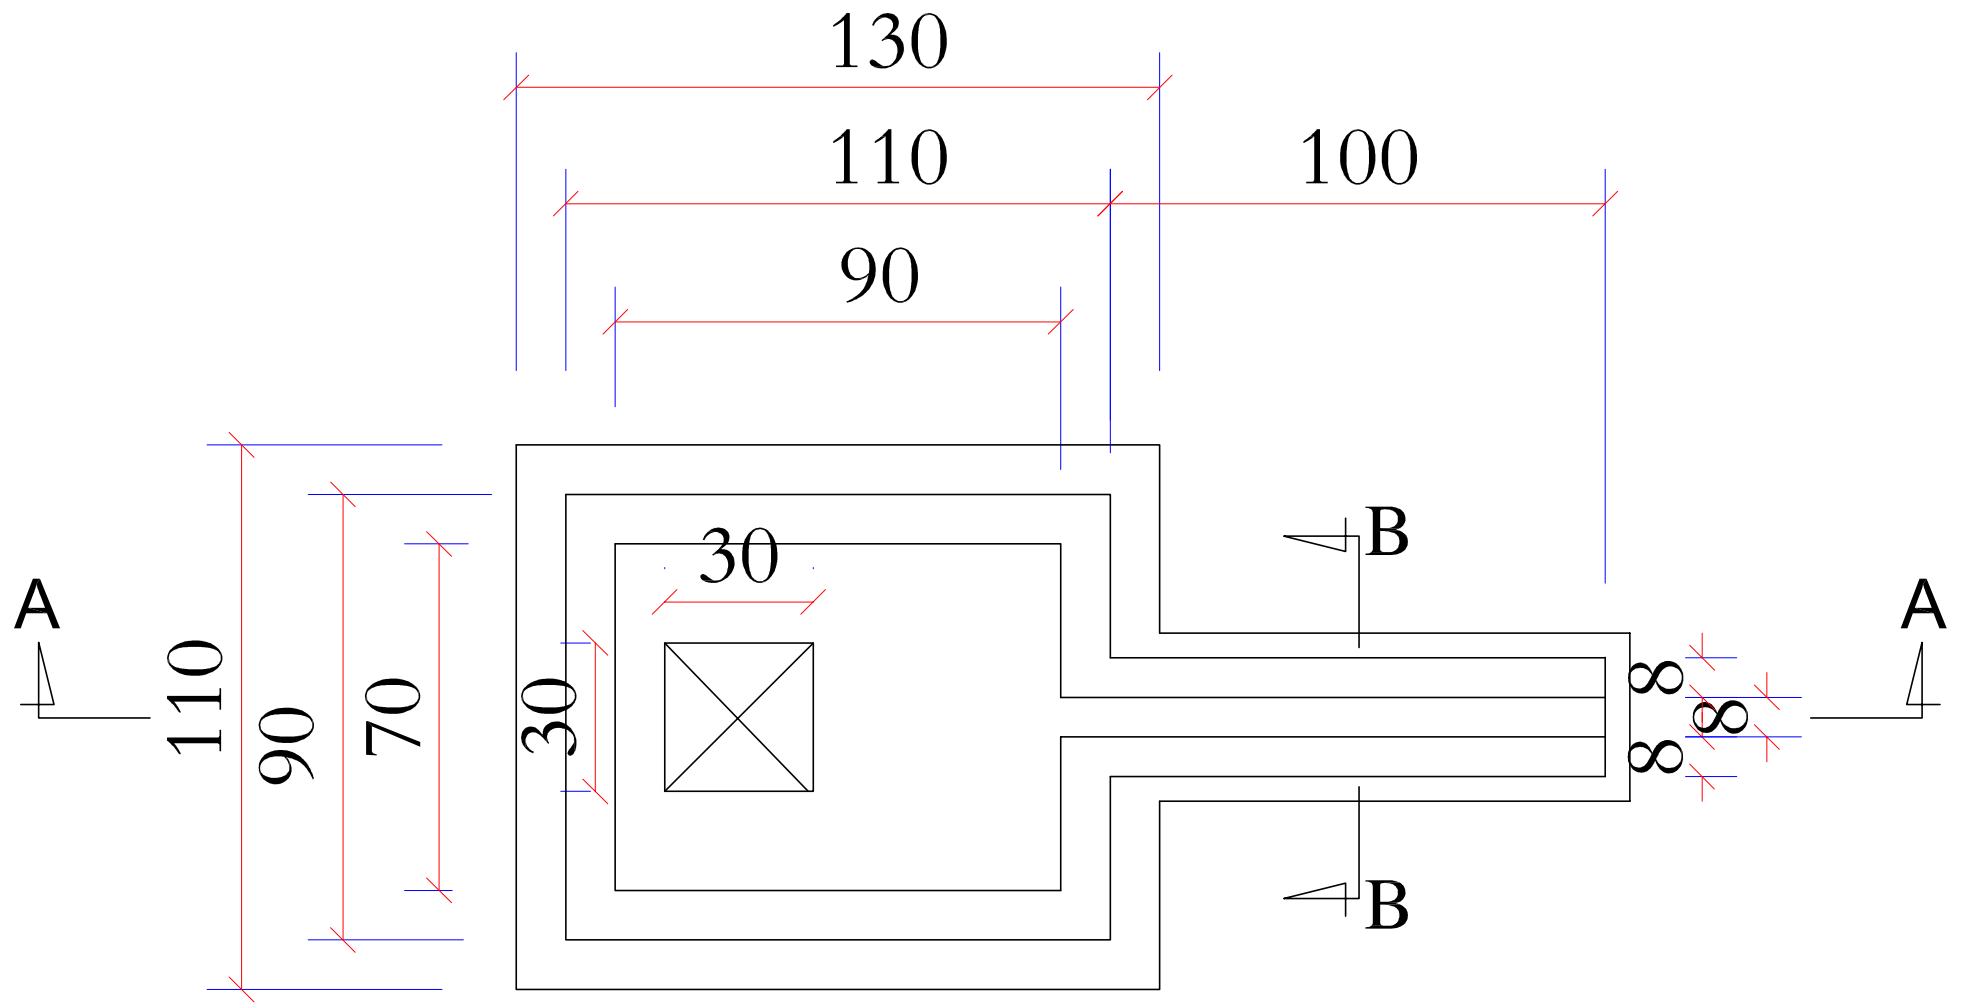 <b>NCA</b>	NCA AFGHANISTAN	SURVEYED BY Eng. Zar Mohammad Ahmadzai	CHECKED BY Eng. Moh. Zahid Haidari	SCALE		SHEET NO. 	PROVINCE Herat	PROJECT NAME <i>Water Supply Project</i>	
		DESIGNED BY Eng. Zar Mohammad Ahmadzai	REVIEWED BY Eng. Farhad Aaqeb	DATE 29/09/2024			DISTRICT Ghoorian	DRAWING TITLE Gate Valve Box (Stone Masonry)	
		DRAWN BY Eng. Zar Mohammad Ahmadzai	APPROVED BY Eng. Farhad Aaqeb	DRAWING NO.			VILLAGE Zangi Saba		




STAND TAP PLAN

 <b>NCA</b>	NCA		SURVEYED BY	Eng. Zar Mohammad Ahmadzai	CHECKED BY	Eng. Farhad Aaqeb	SCALE		SHEET NO. 	PROVINCE	Herat	PROJECT NAME	Water Supply Project
	AFGHANISTAN		DESIGNED BY	Eng. Zar Mohammad Ahmadzai	REVIEWED BY	Eng. Farhad Aaqeb	DATE	29/09/2024		DISTRICT	Ghoorian	DRAWING TITLE	Stand Tap Plan
			DRAWN BY	Eng. Zar Mohammad Ahmadzai	APPROVED BY	Eng. Farhad Aaqeb	DRAWING NO.			VILLAGE	Zangi Saba		

Site Plan of Zangi Saba Village WSN Project, Ghoorian District, Herat Province



Point Table			
S/D	Elevation	Latitude	Longitude
1	770m	34.254910	61.264669
2	782m	34.254919	61.264660
		Water well	Reservoir

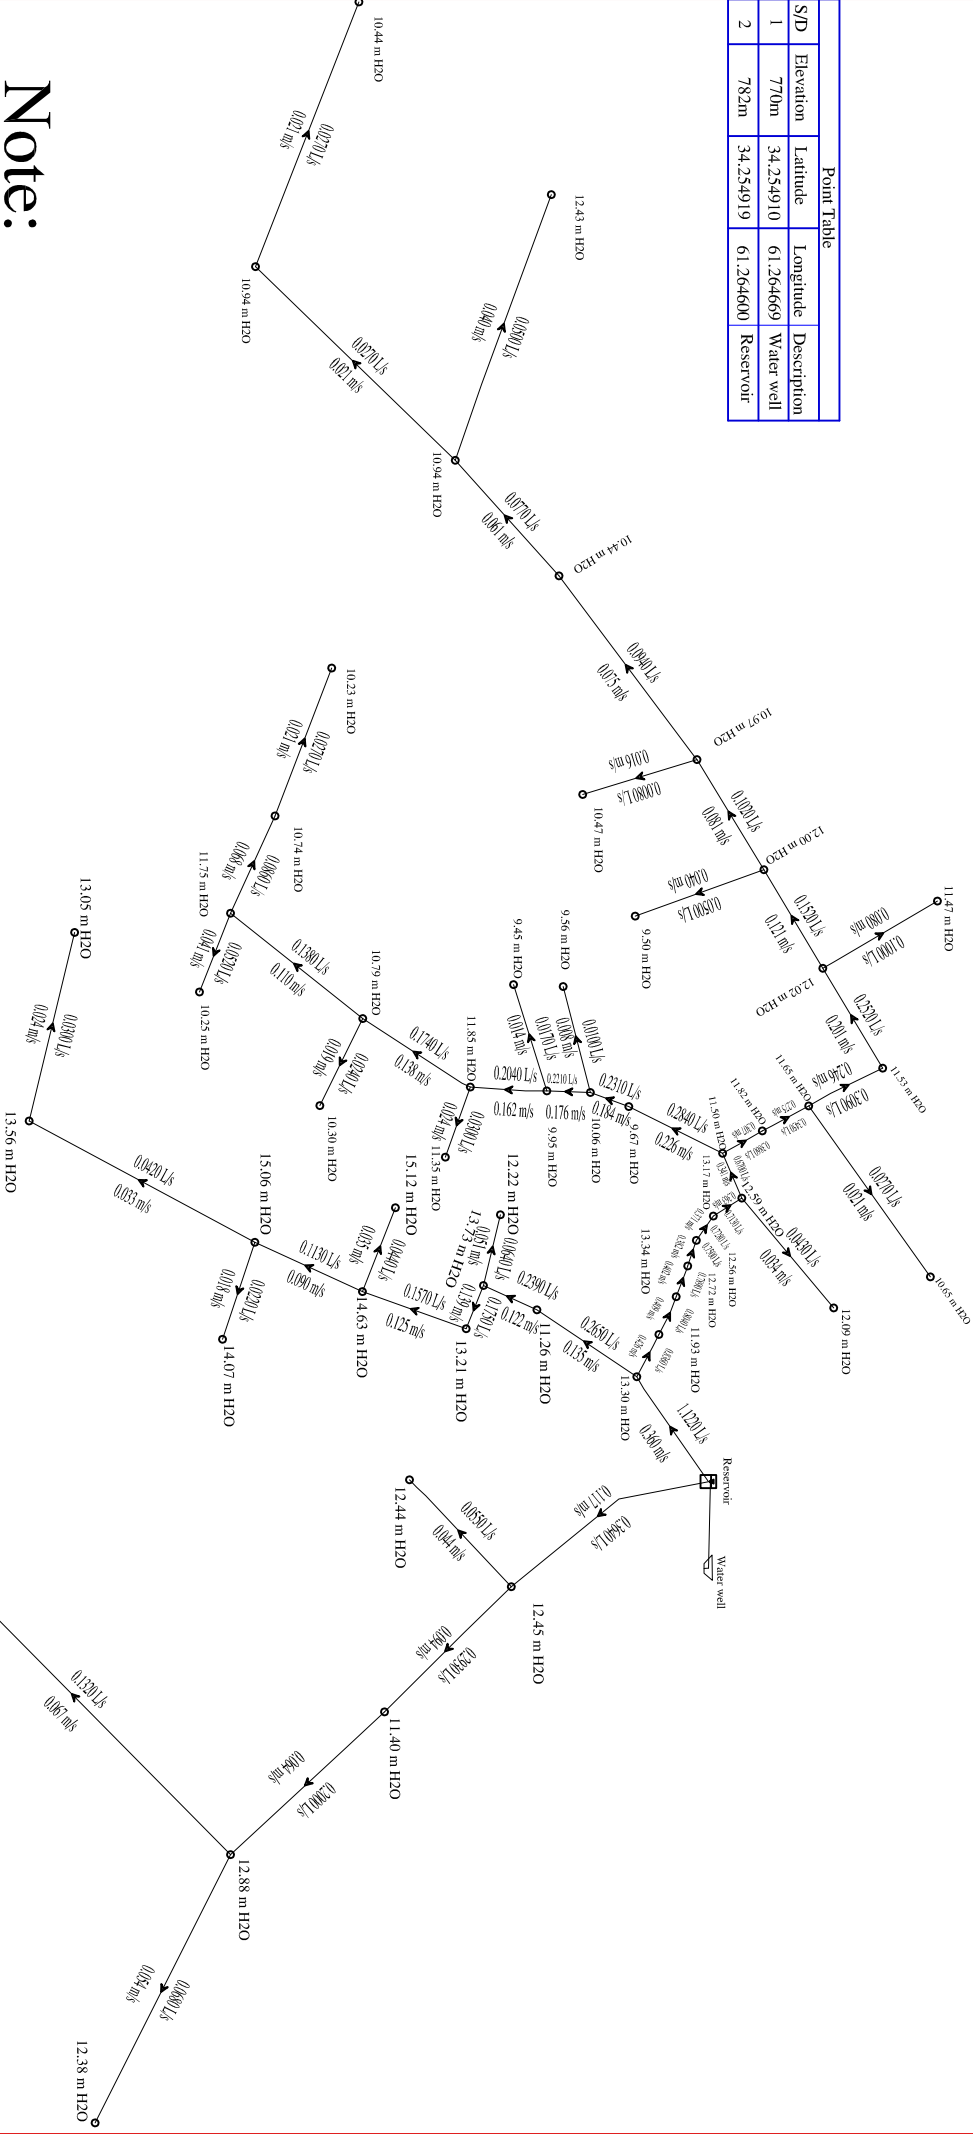


Note:


1. Number of Families 333.
2. Number of Household Connection 150.
3. Construction of 40 M3 RCC Elevated water Reservoir.
4. Construction of Well Protection Structure

Node ID'S, Nodes Pressure (mH2O), Velocity (m/sec), and Flow (Lit/sec)

 NCA AFGHANISTAN	SURVEYED BY Eng. Zar Mohammad Ahmadi	CHECKED BY Eng. Moh. Zahid Haidari	SCALE	SHEET NO. 12	PROVINCE Herat	PROJECT NAME Water Supply Project
	DESIGNED BY Eng. Zar Mohammad Ahmadi	REVIEWED BY Eng. Farhad Auegh	DATE 29/09/2024		DISTRICT Ghoorian	DRAWING TITLE Hydraulic Design (Pressure, Flow and Velocity)
	DRAWN BY Eng. Zar Mohammad Ahmadi	APPROVED BY Eng. Farhad Auegh	DRAWING NO.		VILLAGE Zangi Saba	

# WELL SECTION

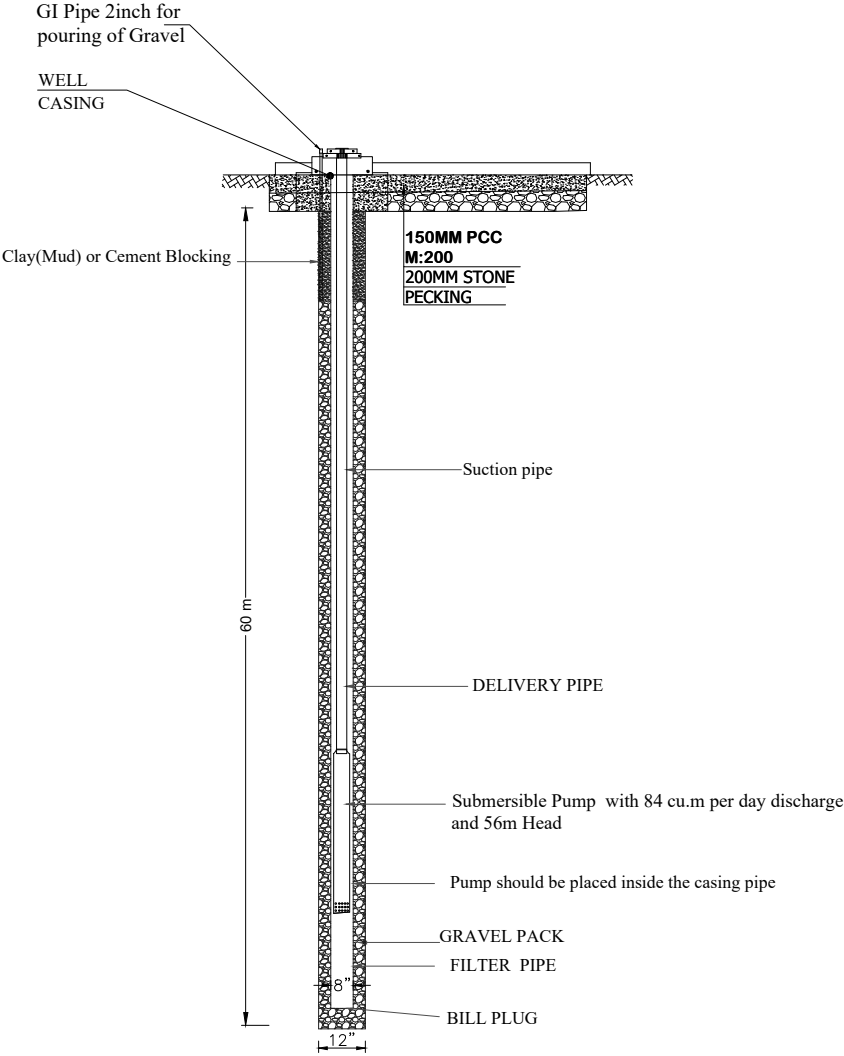

 <b>NCA</b>	NCA	SURVEYED BY	Eng. Zar Mohammad Ahmadzai	CHECKED BY	Eng. Moh. Zahid Haidari	SCALE		SHEET NO. 	PROVINCE	Herat	PROJECT NAME	Water Supply Project
	AFGHANISTAN	DESIGNED BY	Eng. Zar Mohammad Ahmadzai	REVIEWED BY	Eng. Farhad Aaqeb	DATE	29/09/2024		DISTRICT	Ghoorian	DRAWING TITLE	Well Section
		DRAWN BY	Eng. Zar Mohammad Ahmadzai	APPROVED BY	Eng. Farhad Aaqeb	DRAWING NO.			VILLAGE	Zangi Saba		